NOTE: DO NOT SCALE, FIELD DIMENSIONS TO TAKE PRECEDENCE.

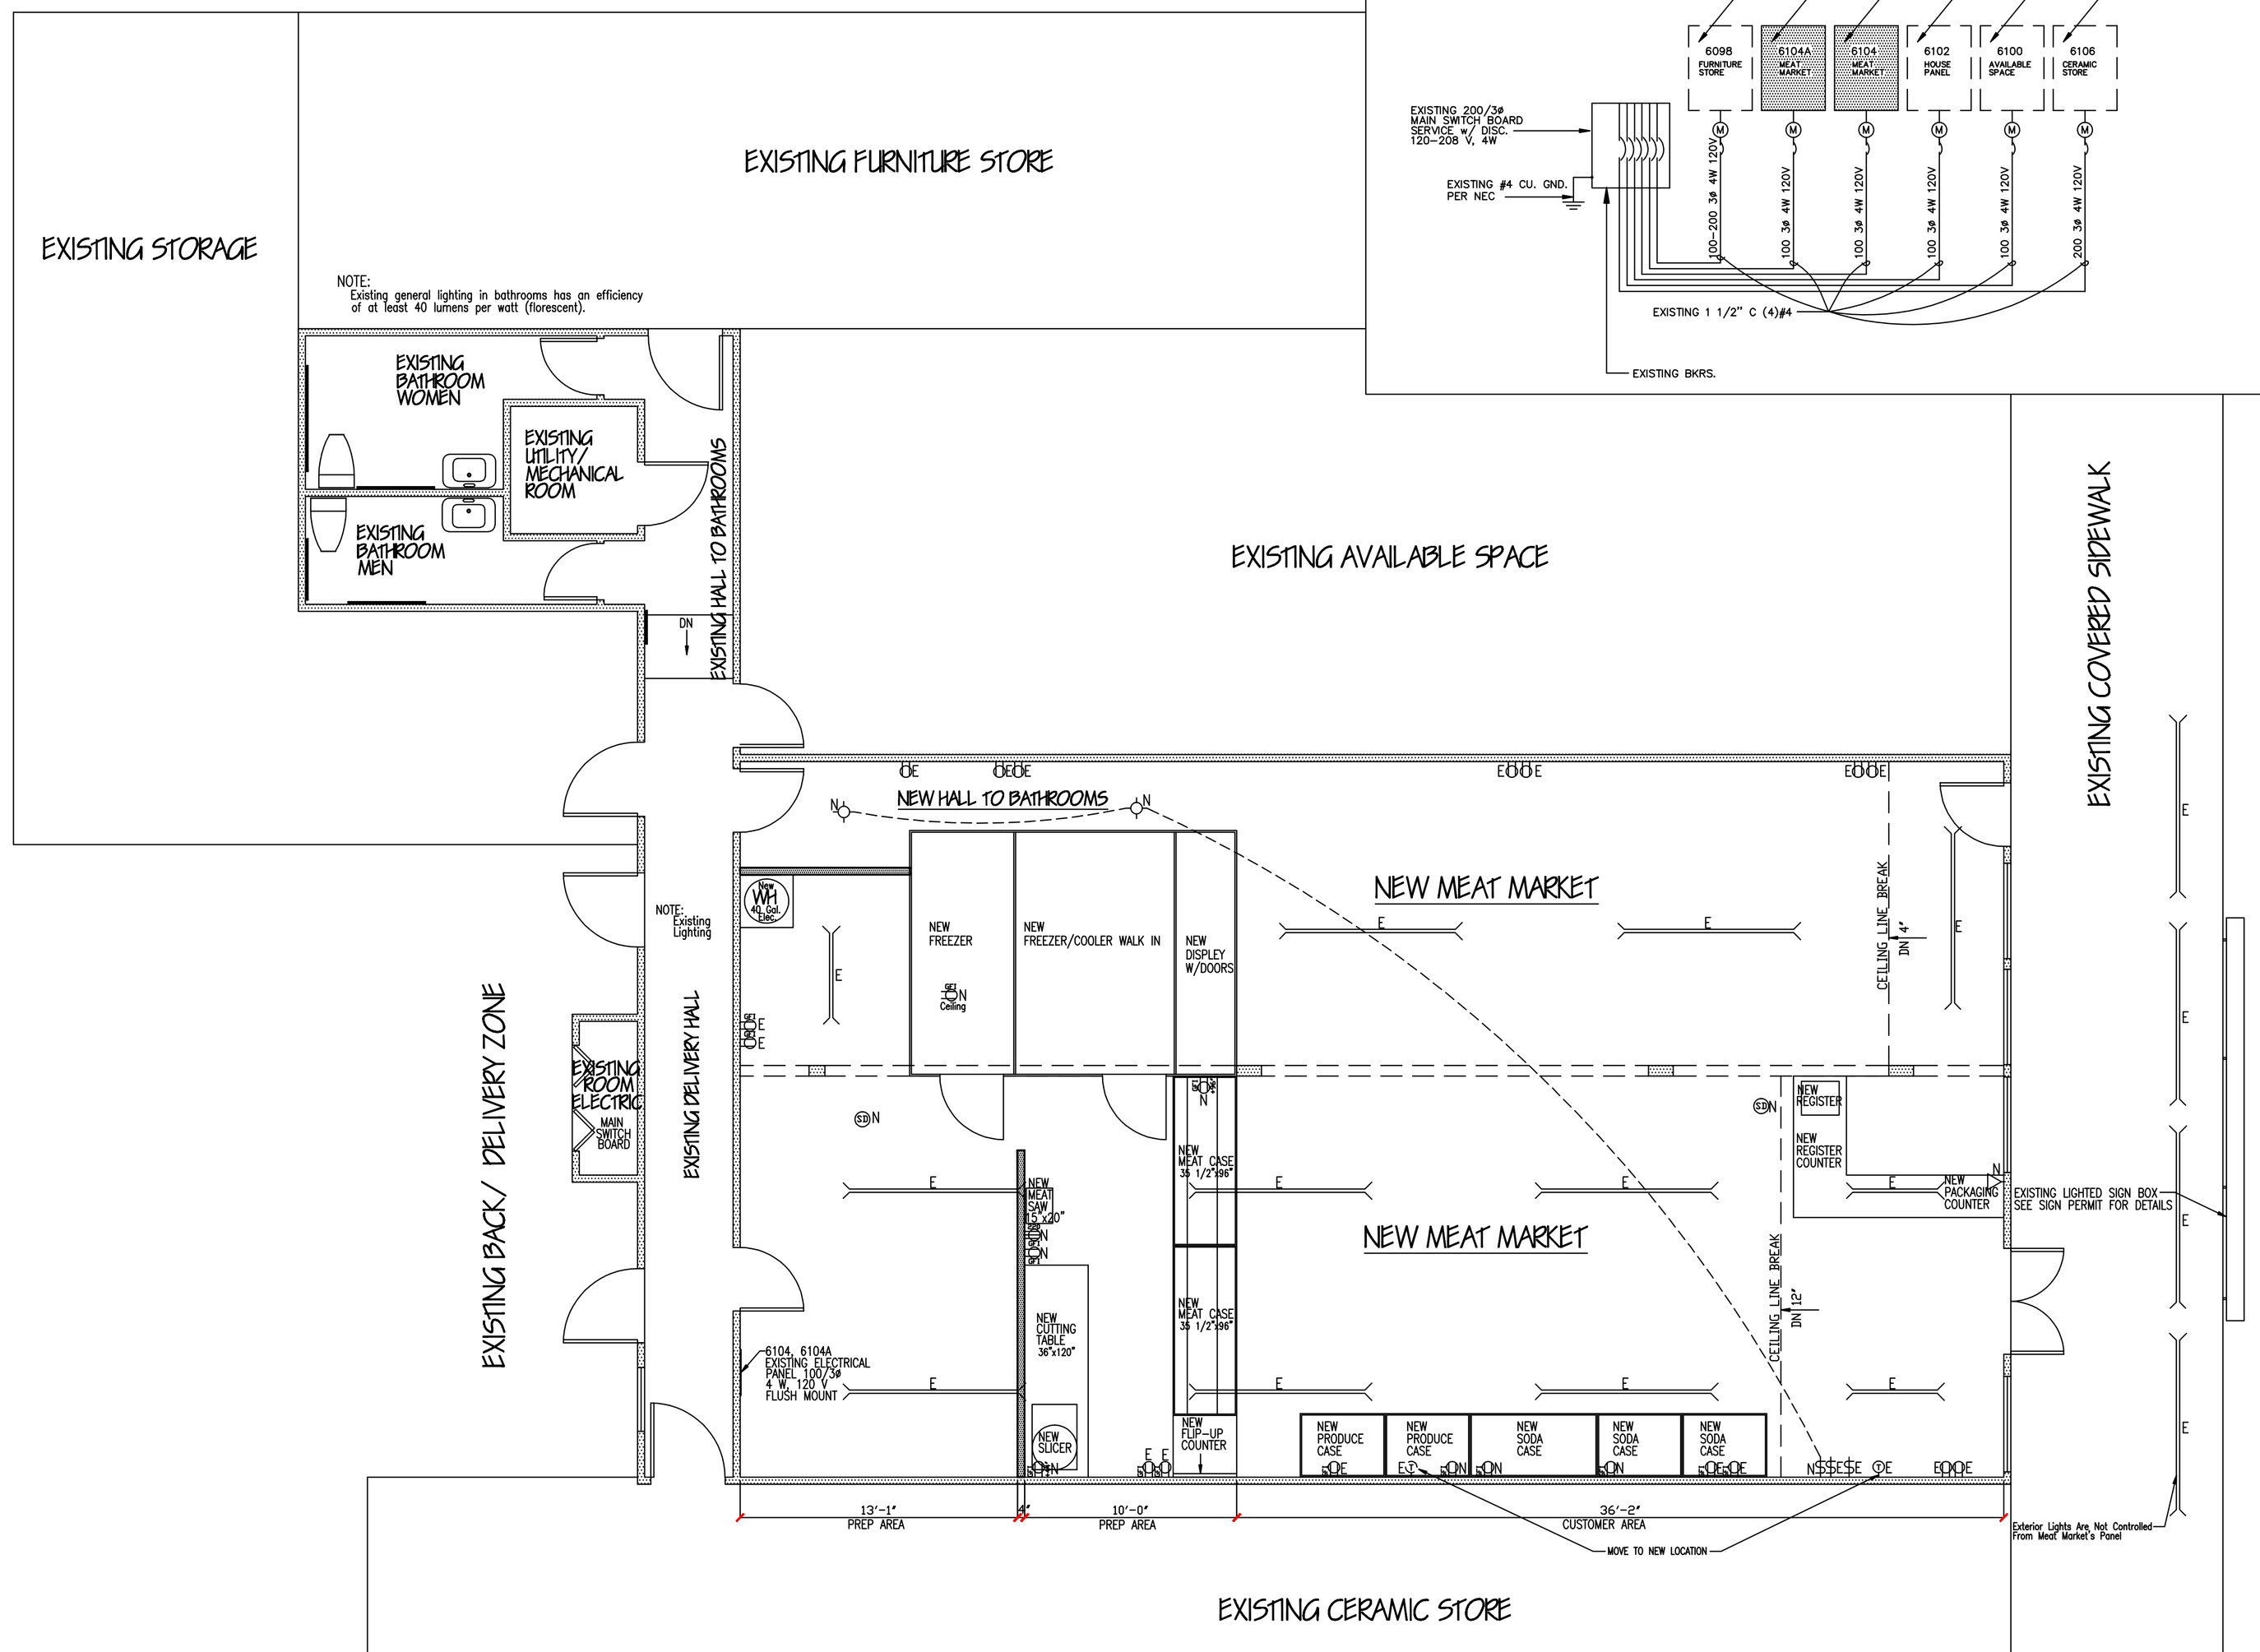

ELECTRICAL PLAN

1/4"=1'-0"

ONE LINE DIAGRAM

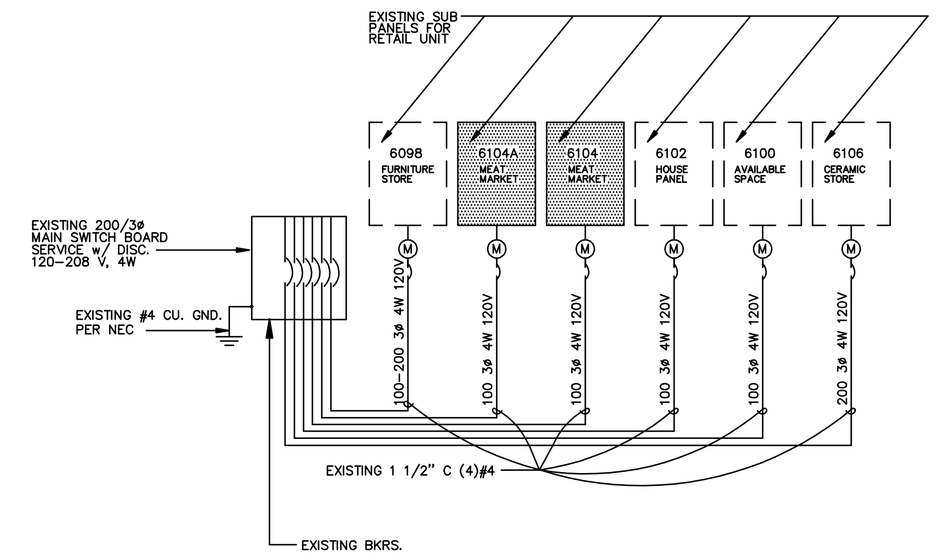

Electrical Plan Notes

1. Provide general lighting having an efficiency of at least 40 lumens per watt (florescent).
2. Light fixtures in tub or shower enclosures shall be labeled "suitable for damp locations".
4. Smoke detectors shall be powered by 110V current with battery backup.
5. Owner to locate specialized outlets & jacks.
6. Provide a weatherproof GFCI electrical receptacle within 25' of AC unit (per UMC 509).
7. All electrical receptacles shall be @ 18" height from the finish floor, unless otherwise noted.
8. All incandescent lighting fixtures recessed into insulated areas shall be approved for zero-clearance insulation cover (I.C.) per the 1992 mandatory energy requirements.

ELECTRICAL SYMBOLS

- Duplex Receptacle Outlet
- Duplex Receptacle w/Cover
- 220 Receptacle
- Light Fixture
- Junction Box
- Exhaust Fan w/Fluorescent Light
- Recessed Light
- Smoke Detector
- Fluorescent Light Fixture
- Thermostat
- Ground Fault Circuit Interrupt
- Weatherproof Outlet
- Single Pole Switch
- Three-Way Switch
- Four-Way Switch
- Telephone

BUILDING DATA:

- 120/240 SINGLE PHASE
- "ROMEX" WIRE TYPICAL
- 15 AMP RECEPTACLE
- "GFI" RECEPTACLES PROVIDED (where applicable)

LEGEND
E – EXISTING
N – NEW

No.	Revision/Issue	Date

Firm Name:
TAYLOR DESIGN AND SERVICES DRAFTING
P. O. Box 905, Rocklin, CA 95677.
KATHLEEN TAYLOR Tel. (916) 624-1649 Fax. (916) 624-4910

Project Name and Address:
Retail Space Remodel For:
YOUR COMPANY
Address
City, CA
Tel: (916) 555-5555.

ELECTRICAL PLAN

File: AR9N6054A3
Date: 11/01/99
Scale: 1/4"=1'-0"
Sheet: 3 Of 4

All drawings on this sheet are copyright by TAYLOR Design and Drafting Services. Any reproduction of these drawings without the written permission of TAYLOR D.D.Svcs. is prohibited.