


FRONT ELEVATION
1/4" = 1'-0"

NOTE:
- ALL WINDOWS TO BE DUEL
GLAZE WITH SCREENS.
- PER OWNERS REQUEST WINDOWS TO
BE INSTALLED RECESSED.

NOTE:
THE HEIGHT OF THE CHIMNEY SHALL EXTEND
A MINIMUM OF 24" ABOVE THE HIGHEST
ELEVATION OF ANY PORTION OF THE ROOF
WITHIN 10' HORIZONTALLY FROM THE CHIMNEY.

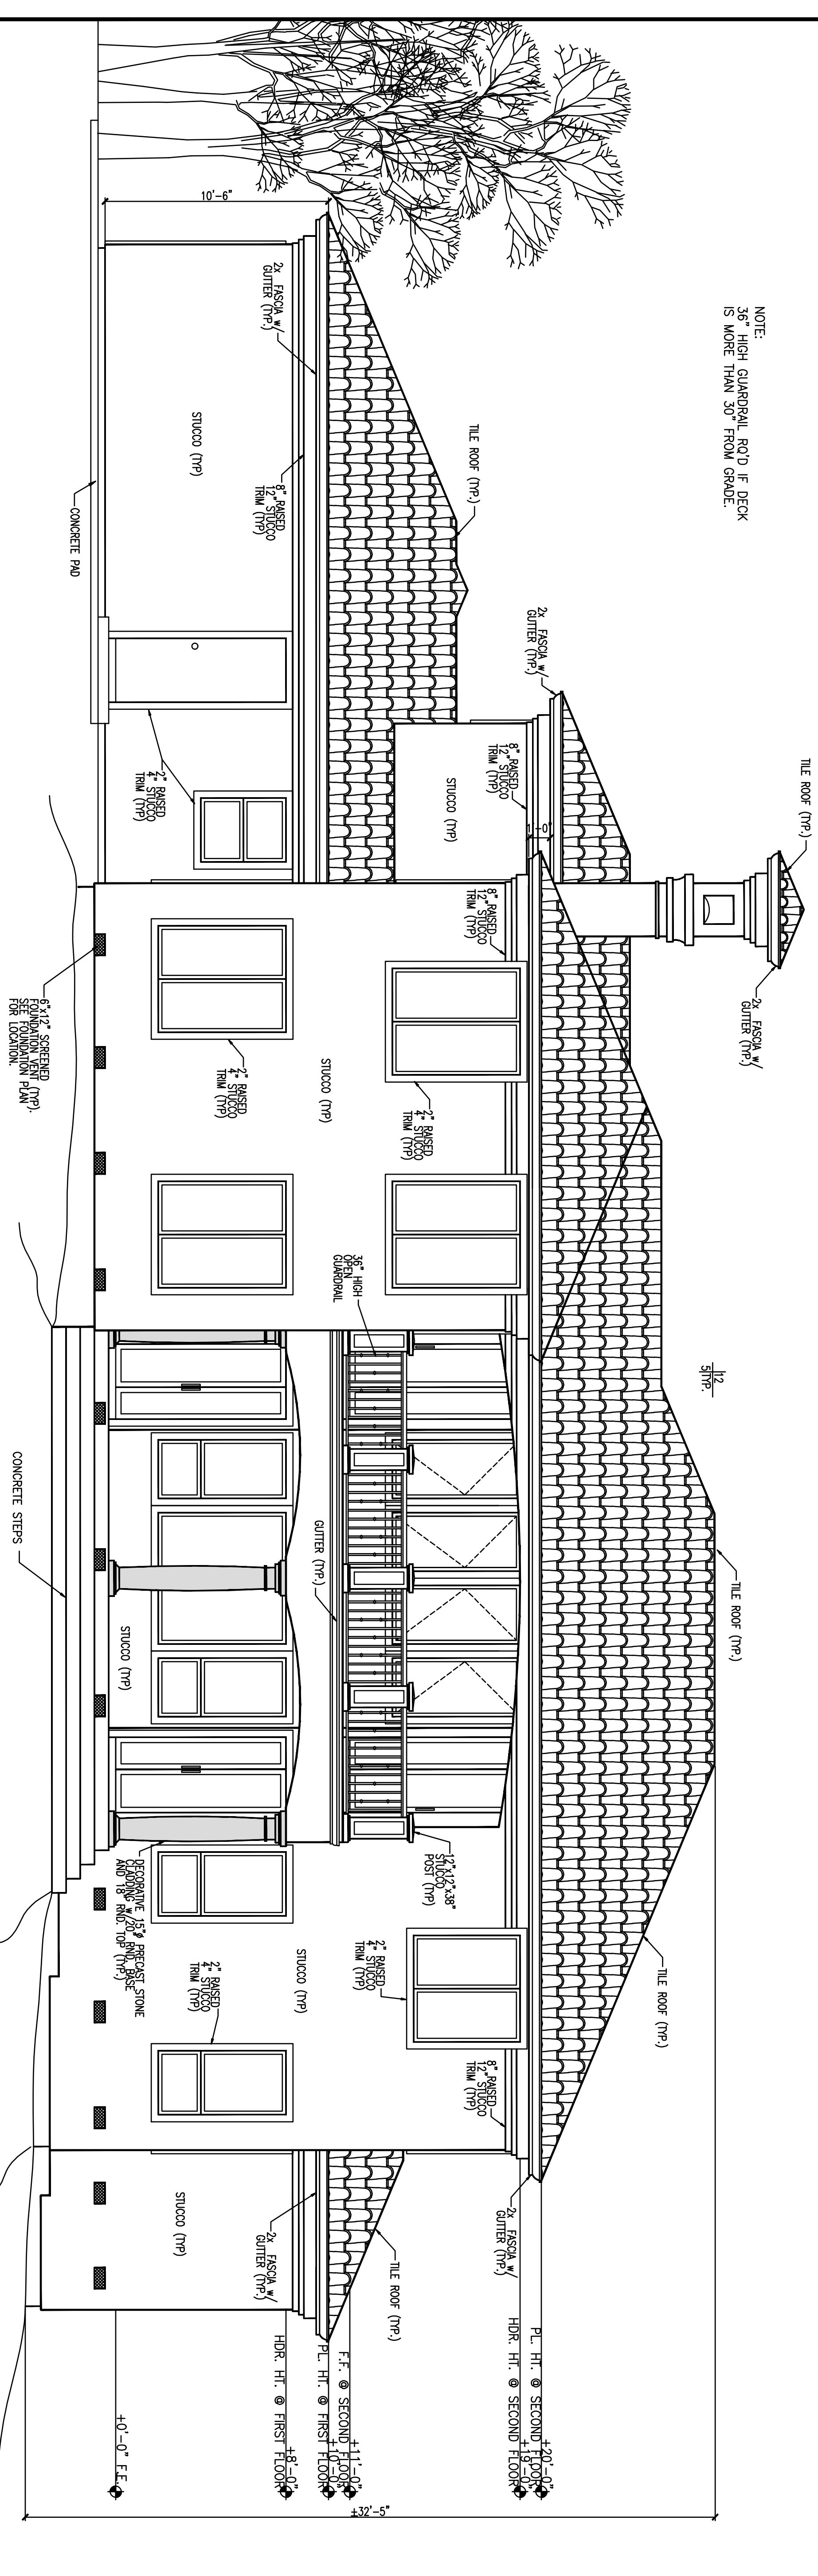

REAR ELEVATION
1/4" = 1'-0"

STUCCO NOTE:
3/8" MESH STUCCO 7/8" MIN. THICK
3/8" GALV. STUCCO 7/8" MIN. THICK
PAPER AND 26 GA. GALVANIZED WEEP
SCREENED AT FOUNDATION PLATE LINE AT
CONCRETE ABOVE GRADE FOR 2508 &
2509 (TYP. EXT. WALL)

General Notes:

When veneer or stucco is applied to a weather-exposed wall where there is human occupancy, there needs to be a felt or kraft paper weather-resistant barrier installed behind the veneer or stucco. A corrosion resistant weep screed which will drain to the exterior of the building is required below the stucco at the foundation plate line. The weep screed must have 4" clearance above the ground and 2" above a concrete/asphalt surface. Factory-built masonry chimneys must terminate at least 3' above the roof penetration and must also be at least 2' above any roof within 10' of the chimney or in accordance with the manufacturer's listing which ever is greater. Wood framed chimney chases need to be anchored to the roof framing by means of straps at all corners or by integrated framing with the roof structure. Milling of the chase wall framing plate to the roof framing is not acceptable. Spark arresters with 3/8" - 1/2" mesh are required on all solid fuel burning chimneys.

No.	Revision/Issue	Date

Firm Name:
TAYLOR DESIGN
SERVICES AND
RATING
P.O. Box 505, Beulah, CA 95977
Tel: 916.291.4649 Fax: 916.291.4900

Custom Home For:
YOUR NAME HERE
Your Address
Your City
Your Phone

File: **N61975714** Sheet: **4**
Date: **05/01/06**
Scale: **1/4" = 1'-0"** Of **17**

All drawings on this sheet are copyright by TAYLOR Design and Drafting Services. Any reproduction of these drawings without the written permission of TAYLOR Design is prohibited.